


- NOTES:**
1. ALL DIMENSIONS IN MILLIMETRES.
 2. ALL CONCRETE TO BE MINIMUM 25MPa.
 3. BULKHEADS TO BE USED WHERE GRADE EXCEEDS 16%. SEE GUIDELINES FOR DETAILS ON SPACINGS.
 4. SEE EN7892 FOR PIPE TRENCH & BEDDING REQUIREMENTS.

CONSULTANT	REV	DESCRIPTION	INITIALS	DATE
	A	ISSUED FOR APPROVAL	-	03-06-98
	B	CHANGE TO BULKHEAD WARRANT SLOPE	-	09-09-04
	C	ADD BOX CULVERT SLAB & CONCRETE WINGED HEADWALL	MC	13-03-09
	D	STRAIGHT/WINGED HEADWALLS & BOX CULVERT SLAB DETAILS REMOVED, NOTES & DRAFTING UPDATES	MC	21-09-23



SURVEYED	-	CHECKED	
DRAWN	MC	TECHNICAL SERVICES MANAGER	
DESIGN	-	DIRECTOR ENGINEERING SERVICES	
DATE	21-09-23		
DATUM	AHD		

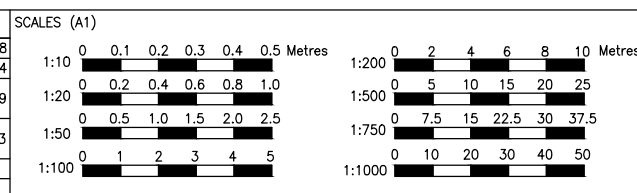

PROJECT	BRC STANDARD CONCRETE BULKHEAD DETAILS		
DESCRIPTION	ELEVATION, CROSS SECTION & NOTES		
DWG No.	SHEET No.	REV.	
EN7895	01	D	